


# 74000 SERIES

## ELECTRICAL SCHEMATICS

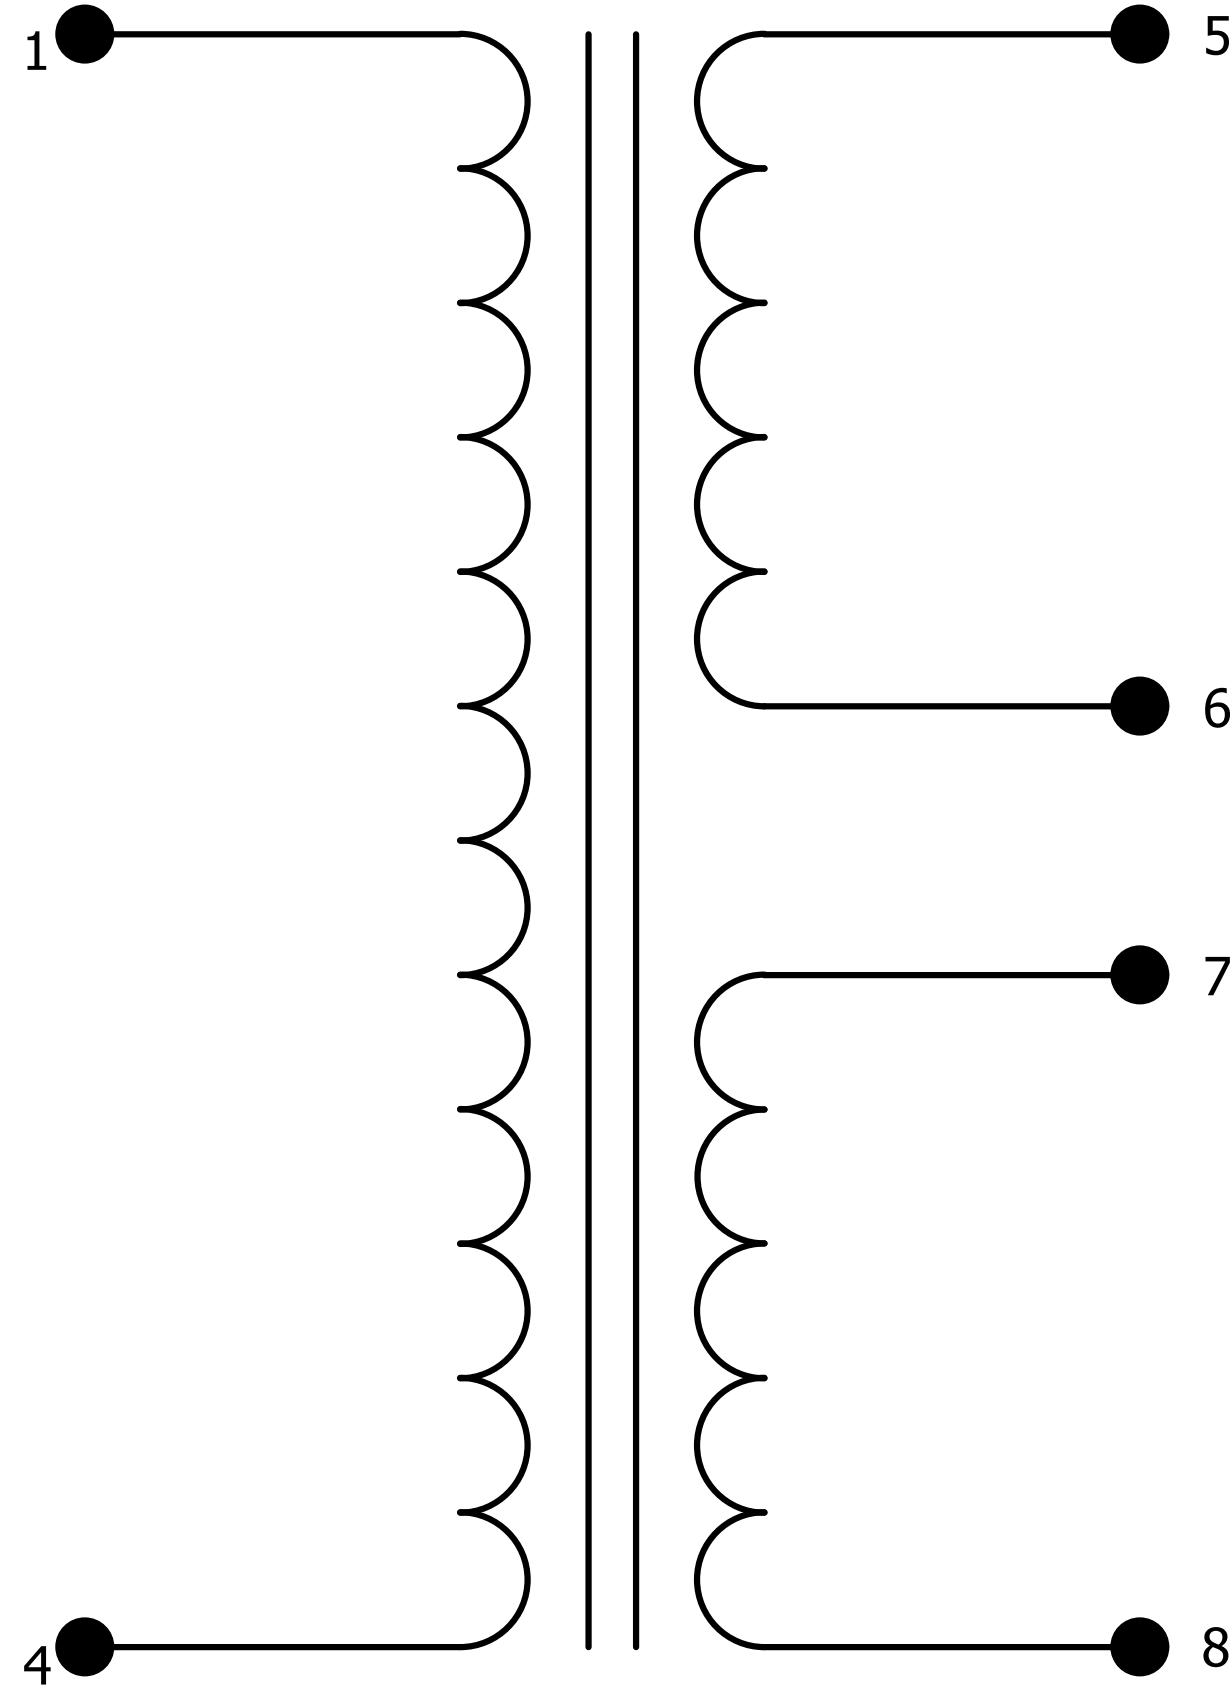

TERMINALS 2 AND 3 HAVE NO CONNECTION.  
MECHANICAL STABILITY ONLY.

DRAWN	P.PALUCH	<b>PICO</b>	143 Sparks Ave	
CHECKED	H. VIDAURRE		Village of Pelham, NY 10803	
QA		<b>Electronics</b>		
MFG		<b>74000 SERIES</b>		
APPROVED		SIZE	DWG NO	REV
REVISION DATE	06/06/2023	<b>C</b>		<b>1</b>
		SCALE	NTS	www.picoelectronics.com